



NOTES:

1. ALL MANHOLE FRAMES AND COVERS SHALL BE EAST JORDAN MODELS 1045Z AND 1040AGS OR APPROVED EQUAL.
2. STEPS TO BE VERTICALLY ALIGNED.
3. THE FRAME AND COVER SHALL BE PROPERLY ALIGNED WITH THE 2 FOOT OPENING OF THE MANHOLE STRUCTURE AND BOLTED IN PLACE.
4. GROUT/CEMENT/CONCRETE/MORTAR SHALL NOT BE PLACED IN/ON ANY SECTION OF THE MANHOLE IN THE FIELD.
5. EXTERIOR SURFACES OF ALL CONCRETE MANHOLE SECTIONS SHALL HAVE TWO COATS (MINIMUM 16 DRY MILS) OF COAL TAR EPOXY, KOPPERS CO. BITUMASTIC 300-M OR EQUAL.

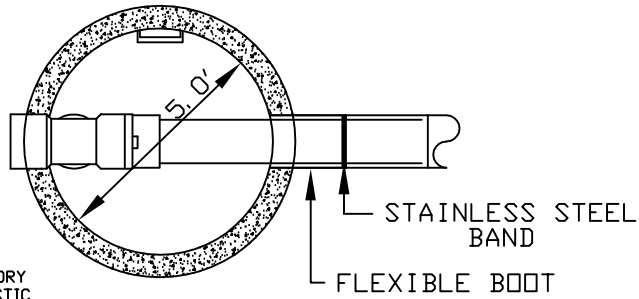

SECTION A-A

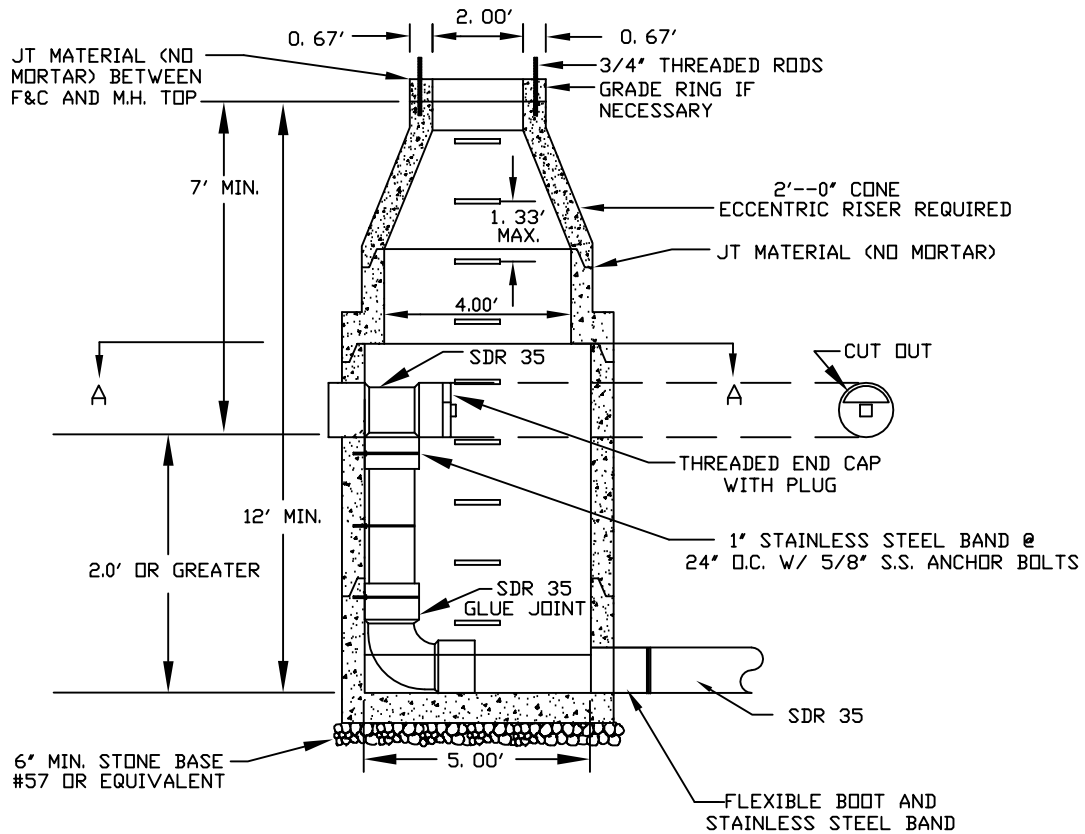

NOTE : 6' DIAMETER MANHOLE REQUIRED
FOR TWO INSIDE DROP CONNECTIONS
(MAIN LINE OR LATERAL)

REVISIONS		MAINLINE OR LATERAL INSIDE DROP MANHOLE (FOR USE WITH PVC PIPE)		DRAWING S-04
NO.	DATE			
ORIGINAL	12/01/06			
1	9/01/07			
2	10/25/07			